

# HIOKI

POWER QUALITY ANALYZER  
PQ3100

NEW

# Quick & Easy Diagnosis of Power System Anomalies

Easy start with Quick Set  
Record up to 11 seconds of event waveforms  
Measure up to 6000 A AC



CE

[www.valuetronics.com](http://www.valuetronics.com)

**Ver 2.00**  
Newly Added Functions

## Reliable power supply maintenance, management, troubleshooting, and analysis

The power grid is the single most important piece of infrastructure in our society, and regular maintenance and management are essential in order to prevent problems. When power supply issues are caused by factors such as equipment malfunctions or rapid surges in power demand, personnel are called upon to analyze the underlying causes quickly and precisely. The PQ3100 aids in reliable power analysis by delivering analytical capabilities that reliably captures the full range of power anomalies along with exceptional ease of use that facilitates each step of instrument operation, from connecting it to the circuit to recording data.



## Recording power quality data for the grid

The PQ3100 records data including voltage, current, power, harmonics, and flicker\* simultaneously along a single time axis, and the included PQ ONE application software makes it easy to create reports.



	U <sub>rms</sub> [V]	I <sub>rms</sub> [A]	F <sub>res</sub> [Hz]
12	397.12	6.267	60.012
23	398.91	15.375	
31	401.25	17.300	


	P[W]	S[VA]	Q[var]	PF
1	1.494k	1.560k	-0.448k	0.9578
2	3.424k	3.526k	-0.847k	-0.9711
3	3.967k	4.006k	-0.554k	-0.9904
SUM	8.885k	9.100k	0.160k	-0.9764

Active energy MP+ 81.569k Wh  
Elapsed time 11:51:34

\* Flicker recording available in future firmware update

## Analyzing device power supply issues

When you need to resolve issues with a device that unexpectedly malfunctions or suddenly stops, the PQ3100 captures all power anomalies, including instantaneous outages, voltage drops, and frequency fluctuations, while simultaneously recording trend data.

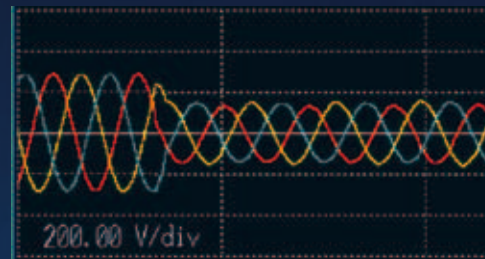

## Measuring AC/DC power

Used in combination with an AC/DC auto-zero current sensor, the PQ3100 can accurately measure DC currents over extended periods of time. Since the instrument supplies power to connected sensors, there's no need to use an additional power supply for sensors.





# Simultaneously measure all parameters at once


## Measuring all parameters at the same time

The PQ3100 makes it easy to verify current conditions by displaying all measurement parameters simply by toggling the screens.


**Ver 2.00** // Newly Added Functions  
If you already have the PQ3100, these can be added through a free firmware update.




Waveforms

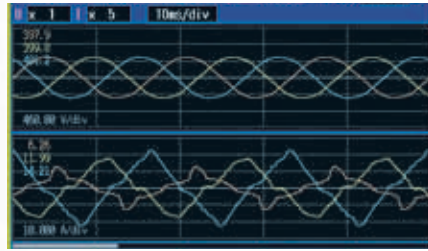

Vectors

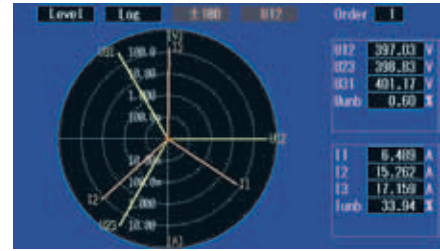

Harmonics

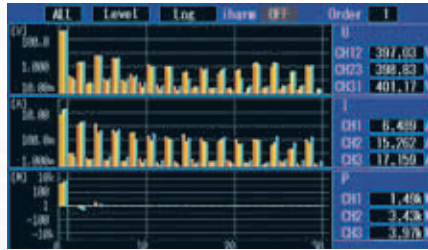

Zoom display

**Ver 2.00**

Urms	12	400.13	V
Irms	1	30.021	A
Freq		50.000	Hz
P	SUM	18.223k	W
S	SUM	20.822k	VA
PF	SUM	0.8752	

RMS values

Urms[V]	Irms[A]	Freq[Hz]
12 397.12	1 6.767	U1 50.012
23 398.01	2 15.375	
31 401.25	3 17.390	

P[W]	S[VA]	D[var]	PF
1 1.494k	1.561k	0.448k	0.9575
2 3.424k	3.576k	-0.343k	-0.9711
3 3.907k	4.006k	0.155k	0.9804
SUM 8.854k	9.100k	0.160k	-0.9764

Active energy kWh: 81.5636 kWh  
Elapsed time: 11:51:34



Switch screens with a single touch


## Simultaneously record trend graphs and event waveforms

The PQ3100 records trend data for all parameters at once. When the PQA detects a power anomaly, the event is immediately recorded. Since maximum, minimum, and average values are recorded during each interval, you'll never miss peak values.

Trend recording



Event waveform recording

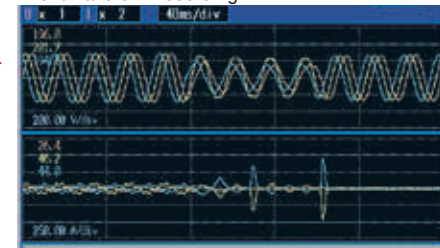

**Ver 2.00**

Dip	THD (voltage)	Interruption	RVC
90.0 %	0.0 %	5.0 %	3.0 %
Transient	Swell	Frequency (200ms)	Inrush current
100 V	110.0 %	0.5 Hz	50.0 A

All triggers can be monitored simultaneously during measurement.


Event statistics

**Ver 2.00**

Time	Type	Value
2017-01-15 10:10:10	Dip	90.0 %
2017-01-15 10:10:15	Swell	110.0 %
2017-01-15 10:10:20	Interruption	5.0 %
2017-01-15 10:10:25	RVC	3.0 %
2017-01-15 10:10:30	Transient	100 V
2017-01-15 10:10:35	Frequency	0.5 Hz
2017-01-15 10:10:40	Inrush current	50.0 A

Check number of occurrences and worst value by event type

Demand recording

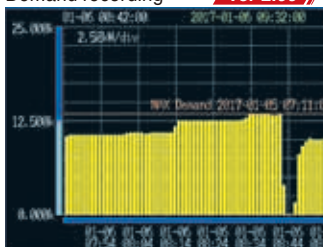

Flicker



30-second event trend data



The PQ3100 also records 1/2 RMS value fluctuations over a period of 30 seconds when a voltage spike, voltage drop, or inrush current occurs. In addition, the instrument can be used to investigate voltage drops caused by inrush current at motor startup.

# Easy wiring and configuration. Reliable measurement.

## Quick Set: Easy-to-understand on-screen guide for measurement procedures

Simply launch Quick Set to navigate - from connecting and configuring the instrument to starting recording.

### Setup Flow (example: 3P4W)

#### STEP 1

Choose the wiring type and connect cables to the instrument.




#### STEP 2

Connect the voltage cables and current sensors to the measurement target.



#### STEP 3


The instrument automatically performs a wiring check and displays the results.

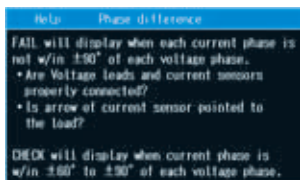

On-screen help notification

#### Example on-screen help:

If the clamp-on sensor is oriented incorrectly, the instrument won't be able to measure power and power factor accurately.




#### STEP 4

Set the parameters to record and the recording interval.

#### STEP 5

Start recording.

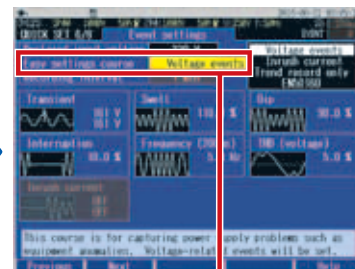

With Easy Setup, you can choose the parameters to record with one touch.

- Voltage events** Capture power supply problems such as equipment anomalies. Voltage-related events will be set.
- Inrush current** Measure inrush current. Threshold is set at 200% of the current RMS. Input voltage into CH1.
- Trend record only** Record trend data only. All event items are set to OFF.
- EN50160** Measure according to the EN50160 standard. Recording interval is set to 10 minutes.

## High basic performance level

### Superior level of safety

The PQ3100 supports CAT III (1000 V) and CAT IV (600 V) measurements.

### High-precision measurement

Voltage RMS value accuracy:  $\pm 0.2\%$  of nominal voltage  
 Swell, dip, interruption:  $\pm 0.3\%$  of nominal voltage  
 The PQ3100 complies with the IEC 61000-4-30 Class S standard.


### Up to 8 hours of battery operation

The PQ3100's energy-saving design means its battery lasts a long time, allowing you to continue measuring following a power outage or make measurements after taking the instrument to sites in the field.

## Convenient functions

### Record 11 seconds of data before and after events

The PQ3100 can record waveforms for up to 1 second before and 10 seconds after an anomaly occurs. This capability is helpful when you need to analyze data bracketing an anomaly or when you need to verify normal return for a solar power conditioner.

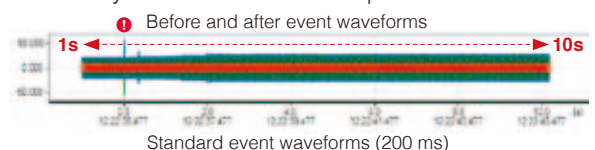

### Extra measuring with CH4

Use CH4 to perform extra measurements for the following parameters.

- Voltage CH4: Measure the electrical potential between the neutral line and the ground line
- Current CH4: Measure the neutral line current, leak current, and current of a separate system



## Clamp sensors that are easy to use anywhere

### Drive sensors without an external power supply

Since the PQA supplies power, there's no need to use a separate AC adapter for AC/DC sensors or flexible sensors.



### Easily install in confined spaces

Flexible current sensors are convenient when making measurements in a confined space and when measuring a two- or three-line power circuit. Measure up to 6000 A AC.



### Measure DC power over extended periods of time

Used in combination with an auto-zero current sensor, the PQ3100 can measure DC power over extended periods of time without the need to worry about zero-point drift.



### Extensive range coverage for use in an array of applications

Use it in a wide range of applications, from the secondary side of CT to wires carrying large currents. The CT7136 lets you choose from the 5 A, 50 A, and 500 A ranges, while the flexible sensor offers the 50 A, 500 A, and 5000 A ranges.



## Rich lineup of interfaces

### Long-term recording of data on an SD memory card

Choose optional cards with 2 GB or 8 GB of capacity.

Recording times when using a 2 GB SD memory card

Recording interval (example values)	Without harmonics	With harmonics	Event recording
200 ms	25 h 40 m	n/a	n/a
1 sec	5 d 7 h	7 h	Yes
2 sec	10 d 14 h	14 h	Yes
10 sec	53 d 12 h	2 d 21 h	Yes
1 min	321 d	17 d	Yes
10 min	1 year	178 d	Yes
30 min	1 year	1 year	Yes

### E-mail function

**Ver 2.00 //**

The built-in e-mail server function can send e-mails whenever an event occurs and at a set time each day.



### Remote control via Ethernet


**Ver 2.00 //**

Make settings and monitor from remote locations. In ver. 2.00 and later, data can be acquired via FTP.



### Wireless transfer to data loggers **Ver 2.00 //**


Connect\* the PQ3100 and the LR8410 Wireless Logging Station (with support of LR8410 Link) via Bluetooth® wireless technology to transmit up to 6 kinds of measured values to the logger, letting you record PQ3100 values in addition to other logger data.

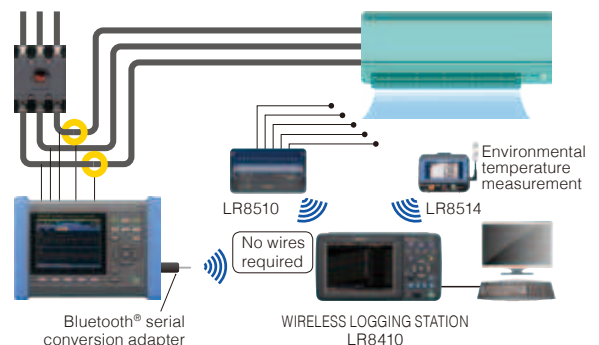

\* Connection requires the serial to Bluetooth® wireless technology conversion adapter recommended by Hioki. Please inquire with your Hioki distributor.


# PQ One: Analyze data and create reports on a PC with a dedicated application

The PQ3100 includes PQ ONE, a power quality analysis application whose latest version can be downloaded free of charge from Hikoki's website.

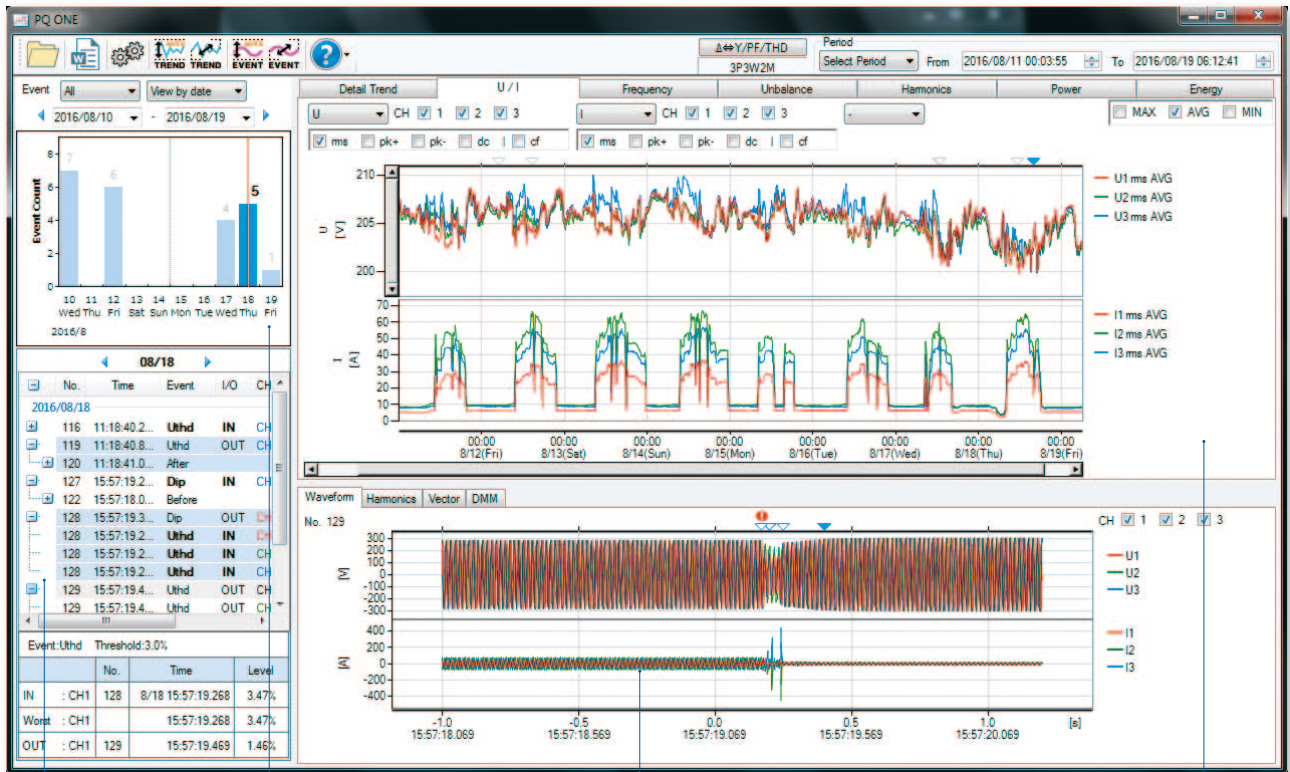

## Event statistics

Display statistics on event occurrence by date and time, making it easy to discover anomalies that occur during specific time periods or days of the week.

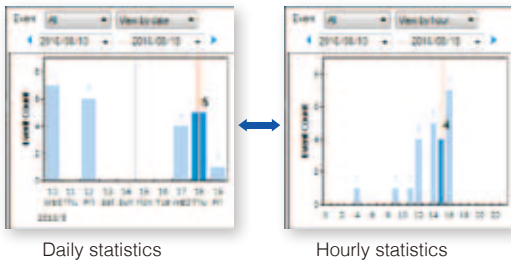

## Event list

Display statistics on event occurrence by date and time, making it easy to discover power supply anomalies that occur during certain time periods or days of the week.

## Report creation

Automatically create reports simply by choosing measurement parameters. If you output the report in Microsoft Word\* format, you can also add comments.



## CSV conversion

Output selected items in CSV format.

## Trend graphs


Display time-series graphs of parameters such as voltage, current, frequency, harmonics, unbalance factor, power, and energy. Configure the display range on screen as desired and create reports by outputting graphs as-is.



Choose measurement parameters, channels, and maximum, minimum, or average values.

## Event details

Analyze 200 ms event waveforms, including parameter waveforms, harmonics, vectors, and value displays. You can also display 30 seconds of event trend data and 11 seconds of pre- and post-event waveforms.

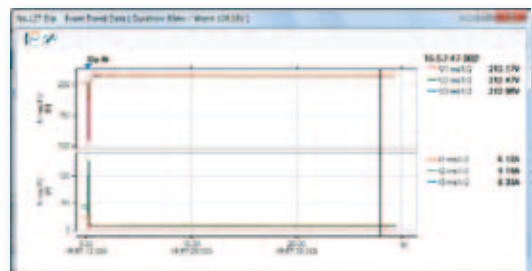

Example voltage drop (30-second event trend data)

\*Microsoft Word is a product of Microsoft Corporation.



Basic specifications	
Input channels	Voltage: 4 channels, Current: 4 channels
Input terminal profile	Voltage: Plug-in terminals (safety terminals) Current: Dedicated connector (HIOKI PL14)
Measurement circuits	Any of the following plus Ch. 4 additional input: Single-phase 2-wire/ DC: 1P2W/ DC Single-phase 3-wire: 1P3W Single-phase 3-wire/1-voltage measurement: 1P3W1U Three-phase 3-wire/2-power measurement: 3P3W2M Three-phase 3-wire/3-power measurement: 3P3W3M Three-phase 4-wire: 3P4W Three-phase 4-wire/2.5 element: 3P4W2.5E
Input methods	Voltage: Isolated input (U1/U2/U3/U4 and N-terminal common differential input, U1/U2/U3/U4 and N not isolated) Current: Isolated input via current sensors
Input resistance	Voltage inputs: 5 MΩ Current inputs: 200 kΩ
Maximum input voltage	Voltage inputs: 1000 V AC/DC, 2200 Vpeak
Maximum rated voltage to earth	1000 V AC (CAT III), 600 V AC (CAT IV) Anticipated transient overvoltage: 8000 V
Measurement method	Digital sampling and zero-cross synchronous computation
Sampling frequency	200 kHz
A/D converter resolution	16 bit
Display range	Voltage: 2 V to 1300 V Current: 0.4% to 130% of range Power: 0.0% to 130% of range Measurement parameters other than above: 0% to 130% of range
Effective measurement range	Voltage: AC: 10 V to 1000 V, peak ±2200 V DC: 5 V to 1000 V Current: 5% to 120% of range, peak ±400% of range Power: 5% to 120% of range (with voltage and current that both fall within effective measurement range)

Accuracy specifications	
Conditions of accuracy guarantee	Accuracy guaranteed for 1 year, Post-adjustment accuracy guaranteed for 1 year Guaranteed accuracy temperature and humidity range: 23°C ±5°C, 80% RH or less Warm up time: 30 m or more
Temperature coefficient	0.1% f.s./°C
Effects of common-mode voltage	0.2% f.s. or less (1000 Vrms AC, 50 Hz/60 Hz, between voltage input and enclosure)
Effects of External magnetic fields	1.5% f.s. or less (in magnetic field of 400 A rms AC/m, 50 Hz/60 Hz)

Measurement items	
Transient voltage, RMS voltage refreshed each half-cycle, Voltage waveform peak, Voltage DC value, Voltage CF value, RMS voltage (phase), RMS voltage (line to line), Swell, Dip, Interruption, RVC, Instantaneous flicker value, RMS current refreshed each half-cycle, Current waveform peak, Current DC value, Current CF value, RMS current, Inrush current, Frequency cycle, Frequency (200ms), 10-sec Frequency, Active power, Active energy, Energy cost, Reactive power, Reactive energy, Apparent power, Apparent energy, Power factor / Displacement power factor, Active power demand capacity*, Reactive power demand capacity*, Apparent power demand capacity*, Active power demand value, Reactive power demand value, Apparent power demand value, Power factor demand value, Voltage unbalance factor (negative-phase, zero-phase), Current unbalance factor (negative-phase, zero-phase), Harmonic voltage, Harmonic current, Harmonic power, Inter-harmonic voltage, Inter-harmonic current, Harmonic voltage phase angle, Harmonic current phase angle, Harmonic voltage-current phase angle, Total harmonic voltage distortion factor, Total harmonic current distortion factor, K Factor IEC flicker, ΔV10 flicker * Only for data output to an SD memory card	

Measurement specifications	
Transient voltage	
Detected from waveform obtained by eliminating the fundamental component (50 Hz/60 Hz) from the sampled waveform.	
Measurement range:	±2.200 kVpeak
Measurement bandwidth:	5 kHz (-3dB) to 40 kHz (-3dB)
Measurement accuracy:	±5.0% rdg. ±1.0% f.s.
Frequency cycle	
Calculated as the reciprocal of the accumulated whole-cycle time during one U1 cycle.	
Measurement accuracy:	±0.200 Hz or less (for input from 50 V to 1100 V)
RMS voltage/ RMS current refreshed each half-cycle	
Calculated as the RMS value of sampling data for 1 waveform overlapped every half-cycle.	
Measurement accuracy:	Voltage With 10 V to 660 V input: ±0.3% of nominal voltage Other than above: ±0.2% rdg. ±0.1% f.s. Current ±0.2% rdg. ±0.1% f.s. + current sensor accuracy
Swell, Dip, Interruption	
Detected when the RMS voltage refreshed each half-cycle value exceeds the threshold.	
Measurement accuracy:	Same as RMS voltage refreshed each half-cycle
Fluctuation:	Saves the RMS voltage and current values refreshed each half-cycle
RVC (Rapid voltage change)	
Detects if the average value for 1 second of the RMS voltage refreshed each half-cycle exceeds the threshold. However, if it goes below the dip threshold or exceeds the threshold, it is detected not as RVC but as dip (or swell).	
Measurement accuracy:	Same as RMS voltage refreshed each half-cycle
ΔUs:	Absolute difference between 1-second average value for RMS voltage refreshed each half-cycle before the event, and first 1-second average value for RMS voltage refreshed each half-cycle after the event [V]
ΔUmax:	Absolute maximum difference between all values for RMS voltage refreshed each half-cycle between events, and 1-second average value for RMS voltage refreshed each half-cycle before the event [V]
Fluctuation:	Saves the RMS voltage and current values refreshed each half-cycle

Instantaneous flicker value measurement specifications (Pinst)	
Measurement method	Complies with IEC61000-4-15.
Inrush current	
Calculated as the current RMS value for current waveform data sampled every half-cycle. Maximum current RMS value from above measurement.	
Measurement accuracy:	±0.3% rdg. ±0.3% f.s. + current sensor accuracy
Fluctuation:	Saves RMS voltage data refreshed each half-cycle and RMS inrush current data.
10-sec frequency	
Calculated as the reciprocal of the accumulated whole-cycle time during the specified 10 s U1 (reference channel) period.	
Measurement accuracy:	±0.010 Hz or less
Frequency (200 ms)	
Calculated as the reciprocal of the accumulated whole-cycle time within 200 ms relative to U1.	
Measurement accuracy:	±0.020 Hz or less
Voltage waveform peak/ Current waveform peak	
Maximum and minimum sampling points in 200 ms aggregation	
Measurement range:	Voltage ±2200.0 Vpk Current Result of adding the crest factor to the current range
Measurement accuracy:	Voltage During input of 10% to 150% of nominal voltage: 5% of nominal voltage Other than above: 2% f.s. Current With at least 50% f.s. input: 5% rdg. + current sensor accuracy Other than above: 2% f.s. + current sensor accuracy
RMS voltage, RMS current	
Measured during 200 ms aggregation in accordance with IEC 61000-4-30.	
Measurement accuracy:	Voltage With 10 V to 660 V input: ±0.2% of nominal voltage Other than above: ±0.1%rdg. ±0.1%f.s.
Current	±0.1% rdg. ±0.1% f.s. + current sensor accuracy
Voltage DC value, Current DC value	
Average value during 200 ms aggregation	
Measurement accuracy:	Voltage ±0.3% rdg. ±0.1% f.s. Current ±0.5% rdg. ±0.5% f.s. + current sensor accuracy
Voltage CF value, Current CF value	
Calculated from the voltage RMS value and the voltage waveform peak value.	
Active power/ Apparent power/ Reactive power	
Active power:	Measured every 200 ms.
Apparent power:	RMS value calculation: Fundamental wave calculation: Calculated from the voltage RMS value and current RMS value. Calculated from the fundamental wave active power and fundamental wave reactive power.
Reactive power:	RMS value calculation: Fundamental wave calculation: Calculated from the apparent power S and active power P. Calculated from the fundamental wave voltage and current.
Measurement accuracy:	
Active power:	DC: ±0.5% rdg. ±0.5% f.s. + current sensor accuracy AC: ±0.2% rdg. ±0.1% f.s. + current sensor accuracy Power factor effects: 1.0% rdg. or less (40 Hz to 70 Hz with a power factor of 0.5)
Apparent power:	±1 dgt. for calculations derived from the various measurement values
Reactive power:	During RMS value calculation: ±1 dgt. for calculations derived from the various measurement values During fundamental wave calculation: For fundamental wave frequency of 45 Hz to 66 Hz ±0.3% rdg. ±0.1% f.s. + current sensor specifications (reactive factor of 1) Reactive factor effects: 1.0% rdg. or less (40 Hz to 70 Hz with reactive factor of 0.5)
Active energy, Reactive energy, Apparent energy	
Measures energy from start of recording.	
Active energy:	Integrated separately by consumption and regeneration from active power.
Reactive energy:	Integrated separately by lag and lead from reactive power.
Apparent energy:	Integrated from apparent power.
Measurement accuracy:	
Active energy:	Active power measurement accuracy ±10 dgt.
Reactive energy:	Reactive power measurement accuracy ±10 dgt.
Apparent energy:	Apparent power measurement accuracy ±10 dgt.
Cumulative time accuracy:	±10 ppm
Energy cost	
Calculated by multiplying the active energy (consumption) WP+ by the electricity unit cost (per kWh).	
Measurement accuracy:	±1 dgt. for calculations derived from the various measurement values
Power factor, Displacement power factor	
Power factor:	Calculated from apparent power S and active power P
Displacement power factor:	Calculated from fundamental wave active power and reactive power.
Displacement power factor measurement accuracy:	
For input with voltage of 100 V or higher, current of 10% of the range or higher	
When displacement power factor = 1: ±0.05% rdg.	
When 0.8 ≤ displacement power factor < 1: ±1.50% rdg.	
When 0 < displacement power factor < 0.8: ±(1-cos(φ + 0.2865) / cos(φ)) × 100% rdg. + 50 dgt. (Reference value)	
φ: Primary display value for harmonic voltage/current phase difference The current sensor phase accuracy is added to each.	
Active power demand capacity, Reactive power demand capacity, Apparent power demand capacity	
Measures each power average value for each interval time.	
Measurement accuracy:	±1 dgt to the calculation from each measured value
Power factor demand value measurement specification	
Calculated from the active power demand value (consumption) Dem_P+ and the reactive power demand value (lag) Dem_Q_LAG.	
Measurement accuracy:	±1 dgt to the calculation from each measured value
Harmonic voltage, Harmonic current	
Complies with IEC61000-4-7: From 1st to 50th order.	
Measurement range:	
Harmonic voltage	RMS: 600.00 V, Content percentage: 100.00 %
Harmonic current	Based on current sensor in use. Content percentage: 500.00 %
Measurement accuracy:	
Harmonic voltage	
Order 0:	Same as voltage DC value
Order 1:	Same as voltage RMS value
Order 2 to 50:	1% of nominal input voltage or greater: ±10.0% rdg. Less than 1% of nominal input voltage: ±0.05% of nominal input voltage
Harmonic current	
Order 0:	Same as current DC value
Order 1 to 20:	±0.5% rdg. ±0.2% f.s. + current sensor accuracy
Order 21 to 30:	±1.0% rdg. ±0.3% f.s. + current sensor accuracy
Order 31 to 40:	±2.0% rdg. ±0.3% f.s. + current sensor accuracy
Order 41 to 50:	±3.0% rdg. ±0.3% f.s. + current sensor accuracy



Harmonic power
----------------

Complies with IEC61000-4-7. Indicates the harmonic power for each channel and the sum value for multiple channels

Measurement accuracy:  
Order 0:  $\pm 0.5\%$  rdg.  $\pm 0.5\%$  f.s. + current sensor accuracy  
Order 1 to 20:  $\pm 0.5\%$  rdg.  $\pm 0.2\%$  f.s. + current sensor accuracy  
Order 21 to 30:  $\pm 1.0\%$  rdg.  $\pm 0.3\%$  f.s. + current sensor accuracy  
Order 31 to 40:  $\pm 2.0\%$  rdg.  $\pm 0.3\%$  f.s. + current sensor accuracy  
Order 41 to 50:  $\pm 3.0\%$  rdg.  $\pm 0.3\%$  f.s. + current sensor accuracy

Inter-harmonic voltage, Inter-harmonic current
--

Complies with IEC61000-4-7. After harmonic analysis, harmonic voltage and current are summed and displayed as inter-harmonic contents with the harmonic contents according to harmonic order From 0.5 to 49.5 th order

Measurement accuracy:  
Inter-harmonic voltage (harmonic input defined for a nominal input voltage of 100 V to 440 V)  
At least 1% of harmonic input nominal voltage :  $\pm 10.0\%$  rdg.  
<1% of harmonic input nominal voltage :  $\pm 0.05\%$  of nominal voltage  
Inter-harmonic current  
No defined accuracy

Harmonic voltage phase angle, Harmonic current phase angle
--

Complies with IEC61000-4-7.

Harmonic voltage-current phase angle
--------------------------------------

Complies with IEC61000-4-7.

Measurement accuracy: Order 1:  $\pm 1^\circ$   
Order 2 to 3:  $\pm 2^\circ$   
Order 4 to 50:  $\pm (0.05^\circ \times k+2^\circ)$  (k: Harmonic order)

However, add current sensor accuracy.  
Defined when the harmonic voltage for each order is 1% of the nominal voltage and the current level is 1% f.s. or greater.

Total harmonic voltage distortion factor, Total harmonic current distortion factor
--

Complies with IEC61000-4-7.

THD-F: Total harmonic distortion factor for the fundamental wave  
THD-R: Total harmonic distortion factor for the total harmonic including the fundamental wave

Measurement accuracy: 0.5%  
Determined for the following input at the nominal input voltage of 100 V to 400 V.  
Voltage, Order 1: 100% of the nominal input voltage, Order 5, Order 7: 1% of the nominal input voltage  
Current, Order 1: 100% of the current range, Order 5, Order 7: 1% of the current range

Voltage unbalance factor (negative-phase, zero-phase)
---

Calculated using various components of the three-phase fundamental wave for three-phase 3-wire (3P3W2M, 3P3W3M) and three-phase 4-wire connections

Current unbalance factor (negative-phase, zero-phase)
---

Calculated using various components of the three-phase fundamental wave for three-phase 3-wire (3P3W2M, 3P3W3M) and three-phase 4-wire connections

K Factor (multiplication factor)
----------------------------------

Calculated using the harmonic RMS current of the 2nd to 50th orders

IEC flicker (Pst/Plt)
-----------------------

Complies with IEC61000-4-15.  
Pst continuously measured for 10 minutes before calculation, Plt continuously measured for 2 hours before calculation

Measurement accuracy: Pst:  $\pm 5\%$  rdg.  
(Determined in IEC61000-4-15 Class F3 performance test)

$\Delta V10$ flicker (dV10)
-----------------------------

The value using a "flicker visibility curve" is 100 V conversation value, measured every minute without gaps.

Value every minute, Average value per hour, Maximum value per hour, 4th maximum value per hour, Total (measurement period) maximum value for  $\Delta V10$   
Measurement accuracy:  $\pm 2\%$  rdg.  $\pm 0.01$  V

(With fundamental wave 100 Vrms (50/60 Hz), fluctuation voltage 1 Vrms (99.5 Vrms to 100.5 Vrms), fluctuation frequency 10 Hz)

Alarm: Set at 0.00 to 9.99 V, performs contact output if the value each minute exceeds the threshold.

RMS value-frequency characteristics
-------------------------------------

Frequency	Voltage	Current	Power
40 Hz to 70 Hz	Defined for RMS voltage	Defined for RMS current	Defined for Active power
70 Hz to 1 kHz	$\pm 3\%$ rdg. $\pm 0.2\%$ f.s.	$\pm 3\%$ rdg. $\pm 0.2\%$ f.s.	$\pm 3\%$ rdg. $\pm 0.2\%$ f.s.
1 kHz to 10 kHz	$\pm 10\%$ rdg. $\pm 0.2\%$ f.s.	$\pm 10\%$ rdg. $\pm 0.2\%$ f.s.	$\pm 10\%$ rdg. $\pm 0.2\%$ f.s.
40 kHz	-3 dB	-3 dB	

## Measurement setting specifications

Wiring	Displays wiring diagram and measured values for: Ch. 1/2/3: 1P2W, 1P3W, 1P3W1U, 3P3W2M, 3P3W3M, or 3P4W Ch. 4: On or off
--------	--

Voltage range	1000.0 V
---------------	----------

Current sensors and current ranges	CT7126: 50 A / 5 A / 500 mA CT7131: 100 A / 50 A / 5 A CT7136: 500 A / 50 A / 5 A CT7116: 5 A / 500 mA / 50 mA CT7731: 100 A / 10 A CT7736: 500 A / 50 A CT7742: 2000 A / 1000 A / 500 A CT7044/CT7045/CT7046: 5000 A / 500 A / 50 A
------------------------------------	---

(Accuracy guaranteed up to 120% of range)	
---	--

Power range	
-------------	--

(Determined automatically based on current range in use.)

Wiring	1P2W	1P3W 1P3W1U 3P3W2M 3P3W3M	3P4W
Current range			
500.00 mA	500.00 W	1.0000 kW	1.5000 kW
5.0000 A	5.0000 kW	10.000 kW	15.000 kW
50.000 A	50.000 kW	100.00 kW	150.00 kW
500.00 A	500.00 kW	1.0000 MW	1.5000 MW
5000.0 A	5.0000 MW	10.000 MW	15.000 MW
10.000 A	10.000 kW	20.000 kW	30.000 kW
100.00 A	100.00 kW	200.00 kW	300.00 kW
1000.0 A	1.0000 MW	2.0000 MW	3.0000 MW
2000.0 A	2.0000 MW	4.0000 MW	6.0000 MW

CT ratio	0.01 to 9999.99
VT ratio	0.01 to 9999.99
Declared input voltage	100/ 101/ 110/ 115/ 120/ 127/ 200/ 202/ 208/ 220/ 230/ 240/ 277/ 347/ 380/ 400/ 415/ 440/ 480/ 600/ User-defined (50 V to 800 V in increments of 1 V)
Frequency	50 Hz/ 60 Hz
Sensor recognition	Automatic recognition of current sensors
Calculation method selection	Urms: Phase voltage or line voltage PF/Q/S: RMS value calculation or fundamental wave calculation THD: THD-F or THD-R Harmonics: All levels / All content percentages / U, P content percentages, I level
Energy cost	Unit cost: 0.00000 to 99999.9 (per kWh) Currency unit: 3 alphanumeric characters
Flicker	Pst/ Plt/ $\Delta V10$
Filter	User-selectable from 230 Vlamp/120 Vlamp (when Pst and Plt are selected for flicker measurement)

## Recording settings

Storage location	SD memory card
Display of remaining storage space (in time)	Calculates and displays remaining time based on the available space left on the SD memory card and in internal memory, the recording interval, and the recording parameters. This information is also updated during trend measurement.
Recording interval	200 or 600 ms; 1, 2, 5, 10, 15, or 30 sec; 1, 2, 5, 10, 15, or 30 min; 1 or 2 hour; 150 or 180 cycles *The following functionality is not available during 200/600 ms operation: Saving of harmonic data (except total harmonic distortion and K factor) Event recording COPY key operation during recording
Recording parameters	With or without harmonics Records maximum, minimum, and average values in binary format.
Saving of screenshots	Off or on Saves the displayed screen at the recording interval as a BMP file. Minimum interval: 5 m
Methods for starting recording	Precise time, manual, time specification, or repeated
Methods for stopping recording	Manual, time specification, timer, or repeated Maximum recording/measurement time: 1 year
Recording time period	Allows user to set the time period for which to record data during repeated recording.
File/folder names	Automatic or user-specified (using 5 single-byte characters)

## Event settings

Event hysteresis	0% to 10% For swell, dip, and outage: % of the nominal voltage. For frequency, fixed to 0.1 Hz. For RVC, fixed to 50% of the threshold. For all other items, % of the threshold.
Timer event count	Off; 1, 2, 5, 10, 15, or 30 min; 1 or 2 hour Generates events at the selected interval.
Event waveform	Instantaneous waveform for approx. 200 ms aggregation (12.5 kS/s)
Pre-event waveform	Off (0 s), 200 ms, 1 sec Allows user to set the recording time for the instantaneous waveform before event occurrence.
Post-event waveform	Off (0 s), 200 ms, 400 ms, 1 sec, 5 sec, 10 sec Allows user to set the recording time for the instantaneous waveform after the event.

## Event specifications

Event detection method
------------------------

Events can be detected at a recording interval of 1 sec or greater.  
See the measurement specifications for a description of detection methods for each event type's measured values.

External events: Events are detected by detecting signal input to the EVENT IN terminal.  
Manual events: Events are detected based on MANUAL EVENT key presses.

Synchronized saving of events
-------------------------------

Event waveform:  
The instantaneous waveform when an event occurs is recorded for 200 ms.  
Depending on settings, the instantaneous waveform can be recorded up to 1 second before the event occurs and up to 10 seconds after it occurs.

Transient waveform:  
The instantaneous waveform can be recorded 1 ms before and 2 ms after the detection position of the transient voltage waveform.

Fluctuation data:  
RMS value fluctuation data is recorded every half-cycle for the equivalent of 0.5 s before the event and 29.5 s after the event.

## Other functionality

Screen shot	Saves the contents of the screen when the COPY key is pressed to the SD memory card. Data format: Compressed BMP
Key lock	Disables all key operation except the POWER key.
SD memory card eject	Pressing the F key on the FILE screen during recording with a recording interval of 2 sec or greater displays a confirmation and allows the SD memory card to be ejected.
System reset	Reverts the instrument's settings to their default values.
Automatic detection of current sensors	When selected on the settings screen, automatically detects connected Hioki PL14 connector-compatible sensors.
Behavior in event of power outage	If a Z1003 Battery Pack with remaining power is installed in the instrument, the instrument automatically switches to battery power and continues recording. If not, measurement operation stops, but settings up to that point are backed up, and the instrument will start recording again when power is restored. However, integration values and related data will be reset, and integration will start again when power is restored.

## Interface specifications

<b>SD memory card</b>	
Compatible cards: Z4001, Z4003	
<b>LAN Interface</b>	
Connector:	RJ-45 connector × 1
Electrical specifications:	IEEE 802.3 compliant
Transmission method:	100Base-TX
Protocol:	TCP/IP (with DHCP function)
Functionality:	Allows remote operation of the instrument from an Internet browser. Data automatic transmission via the FTP client function Data manual acquisition via the FTP server function E-mail transmission
<b>USB interface</b>	
Connector:	Series B receptacle × 1
Version/mode:	USB 2.0 (Full Speed, High Speed), mass storage class
<b>RS-232C interface</b>	
Connector:	D-sub 9-pin connector × 1
Communication method:	RS-232C, EIA RS-232D, CCITT V.24, and JIS X5101 compliant Full duplex, start stop synchronization, data length of 8, no parity, 1 stop bit
Communications speed:	19,200 bps / 38,400 bps
Functionality:	Allows measurement and measurement data retrieval using communications commands. LR8410Link compatible.
<b>External control interface</b>	
Connector:	4-pin screwless terminal block External event input: [IN], [GND1] External event output: [OUT], [GND2]
Event input:	Shorts between the [GND1] and [IN] terminals (active-low) and the falling edge of pulse signals are recognized as event input. Not isolated ([GND1] is common with the instrument's GND.) Maximum rated terminal-to-terminal voltage: 45 V DC Voltage input (high: 2 V to 45 V; low: 0 V to 0.5 V) High interval: At least 100 ms; low interval: at least 100 ms
External output:	Open collector, 30 V / 5 mA max. (photocoupler-isolated) TTL low output via external output settings between the [GND2] and [OUT] terminals TTL low output at event generation between [GND2] and [OUT] terminals Short pulse: Starts/stops measurement at width of approx. 10 ms; outputs pulse at event IN point. Long pulse: Outputs pulse at event IN point only at width of approx. 2.5 s. $\Delta V10$ alarm: TTL low output during $\Delta V10$ alarm Stops recording, returns to high, waiting for recording to begin



## System settings

Beep tone	On or off
LCD backlight	Auto-off (2 m) or on
Display languages	Japanese, English, Chinese (traditional or simplified), Korean, German, French, Italian, Spanish, Turkish, Polish
Phase naming convention	R/S/T, A/B/C, L1/L2/L3, or U/V/W

## General Specifications




Operating environment	Indoors, altitude up to 3000 m Pollution degree 2
Operating temperature and humidity	-20 to 50°C (-4 to 122°F), 80% RH or less (non-condensating)
Storage temperature and humidity	-20 to 50°C (-22 to 122°F), 80% RH or less (non-condensating)
Dust and water resistance	IP30 (EN 60529)
Applicable standards	Safety: EN 61010 EMC: EN 61326 Class A
Standard compliance	Harmonics: IEC 61000-4-7 IEC 61000-2-4 Class 3 Power quality: IEC 61000-4-30 Class S EN 50160 IEEE 1159 Flicker: IEC61000-4-15
Internal memory capacity	4 MB
Power supply	[Z1002 AC Adapter] 100 V to 240 V AC, 50 Hz/60 Hz Anticipated transient overvoltage: 2500 V Maximum rated power: 80 VA (including AC adapter) [Z1003 Battery Pack] Charging time: Max. 5 h 30 m Continuous operating time: Approx. 8 h
Maximum recording interval	1 year
Maximum number of recordable events	9999
Clock functionality	Auto calendar, automatic leap year detection, 24-hour clock
Real-time clock accuracy	±0.5 s per day (with instrument on and within operating temperature range)
Display	6.5-inch TFT color LCD Display refresh: 0.5 s
Dimensions	300 mm (11.81 in) W × 211 mm (8.31 in) H × 68 mm (2.68 in) D (excluding protrusions)
Mass	2.5 kg (88.2 oz) (including battery pack)
Product warranty period	3 year
Accessories	Instruction manual, Measurement guide, VOLTAGE CORD L1000-05, Color clips, AC ADAPTER Z1002, strap, USB cable, BATTERY PACK Z1003, PQ ONE (software, CD)




## Comparison of PQ3100 and PW3198 specifications




Model	PQ3100	PW3198	
			
AC/DC	Yes	Yes	
Fundamental frequency	DC/ 50 Hz/ 60 Hz	DC/ 50 Hz/ 60 Hz/ 400 Hz	
Measurement lines	Single-phase 2-wire, single-phase 3-wire, three-phase 3-wire, three-phase 4-wire + Ch. 4	Single-phase 2-wire, single-phase 3-wire, three-phase 3-wire, three-phase 4-wire + Ch. 4	
Voltage input	Number of channels	4 (U4: Not isolated)	
	Maximum terminal-to-ground rated voltage	1000 V (measurement category III) 600 V (measurement category IV)	
Current input	Number of channels	4	
	Power supply for sensors	Yes	
Measurement parameters	Voltage	1/2 RMS value (half-wave offset wave calculation), RMS value, waveform peak, Voltage DC, Unbalance factor (negative-phase, zero-phase), frequency (1 wave/ 200 ms/ 10 sec.) Crest factor	
	Current	Inrush current (half-wave), RMS value, waveform peak, Current DC, Unbalance factor (negative-phase, zero-phase), K factor 1/2 RMS value (half-wave offset wave calculation), crest factor	
	Power	Active power, Reactive power, Apparent power, Power factor, Displacement power factor, Active energy, Reactive energy Apparent energy, Electrical charges	
	Flicker	Pst, Plt, $\Delta V10$ (3 channels simultaneously)	
	Harmonics	0th order (DC) to 50th order, Voltage/ Current/ Power, Phase angle (voltage/ current), Voltage/Current phase difference, Total harmonic distortion (voltage/ current)	
	Inter-harmonics	0.5 th order to 49.5 th order, voltage/ current	
	High-order harmonics	n/a	
Time-series measurement	Recording period	Max. 1 year	
	Recording interval time	200 ms/600 ms/150 cycles (with 50 Hz input)/1/2/5/10/15/30 sec. to 2 h	
Event measurement	Maximum number of recordable events	9999 events × 365 days of repeat operation	
	Event statistical processing	Displays the number of occurrences by event per day.	
	Waveform acquisition:	Before event	Max. 1 sec.
		At event	200 ms
After event	Max. 10 sec.		
Event parameters	Measurable event parameters	Voltage Swell/ Dip/ Interruption/ Frequency fluctuations/ Inrush current/ THD RMS value/ Voltage waveform peak/ Current waveform peak/ Comparison of voltage waveforms/ Harmonics/ Unbalance factor/ Power	
	Transient voltage	200 kS/s, 2.2 kV	
Setting aid	QuickSet	Simple Setting feature	
Operating temperature and humidity	-20°C to 50°C (-4°F to 122°F), 80% RH	0°C to 50°C (32°F to 122°F), 80% RH	
IEC 61000-4-30 standard compliance	Class S	Class A	





## Current measurement options

Model	AC CURRENT SENSOR CT7126	AC CURRENT SENSOR CT7131	AC CURRENT SENSOR CT7136	
Appearance				
Rated measurement current	60 A AC	100 A AC	600 A AC	
Measurable conductor diameter	Max. $\phi$ 15 mm (0.59 in)		Max. $\phi$ 46 mm (1.81 in)	
PQ3100 current range and combined amplitude accuracy (45 to 66 Hz)	Current range 50.000 A 5.0000 A 500.00 mA	Combined accuracy 0.4% rdg. + 0.112% f.s. 0.4% rdg. + 0.22% f.s. 0.4% rdg. + 1.3% f.s.	Current range 100.00 A 50.000 A 50.0000 A	Combined accuracy 0.4% rdg. + 0.12% f.s. 0.4% rdg. + 0.14% f.s. 0.4% rdg. + 0.50% f.s.
Phase accuracy (45 to 66 Hz)	$\pm 2^\circ$ or less		$\pm 1^\circ$ or less	
Maximum allowable input (45 to 66 Hz)	60 A continuous		600 A continuous	
Maximum rated voltage to earth	CAT III 300 V			
Frequency band	Accuracy defined to 20 kHz			
Dimensions, mass, cord length	46 mm (1.81 in) W x 135 mm (5.31 in) H x 21 mm (0.83 in) D, 190 g (6.7 oz), 2.5 m (8.2 ft)		78 mm (3.07 in) W x 152 mm (5.98 in) H x 42 mm (1.65 in) D, 350 g (12.3 oz), 2.5 m (8.2 ft)	
Output connector	Hioki PL14			

Model	AC FLEXIBLE CURRENT SENSOR CT7044	AC FLEXIBLE CURRENT SENSOR CT7045	AC FLEXIBLE CURRENT SENSOR CT7046
Appearance			
Rated measurement current	6000 A AC		
Measurable conductor diameter	Max. $\phi$ 100 mm (3.94 in)	Max. $\phi$ 180 mm (7.09 in)	Max. $\phi$ 254 mm (10.00 in)
PQ3100 current range and combined amplitude accuracy (45 to 66 Hz)	Current range 5000.0 A / 500.00 A 50.0000 A		Combined accuracy 1.6% rdg. + 0.4% f.s. 1.6% rdg. + 3.1% f.s.
Phase accuracy (45 to 66 Hz)	$\pm 1.0^\circ$ or less		
Maximum allowable input (45 to 66 Hz)	10,000 A continuous		
Maximum rated voltage to earth	1000 V AC (CAT III), 600 V AC (CAT IV)		
Frequency band	10 Hz to 50 kHz ( $\pm 3$ dB)		
Dimensions, cord length	Flexible loop cross-sectional diameter $\phi$ 7.4 mm (0.29 in) / 2.5 m (8.2 ft)		
Mass	160 g (5.6 oz)	180 g (6.3 oz)	190 g (10.00 oz)
Output connector	HIOKI PL14		

Model	AC/DC AUTO-ZERO CURRENT SENSOR CT7731	AC/DC AUTO-ZERO CURRENT SENSOR CT7736	AC/DC AUTO-ZERO CURRENT SENSOR CT7742				
Appearance							
Rated measurement current	100 A AC/DC	600 A AC/DC	2000 A AC/DC				
Measurable conductor diameter	Max. $\phi$ 33 mm (1.30 in)		Max. $\phi$ 55 mm (2.17 in)				
PQ3100 current range and combined amplitude accuracy	DC	Current range 100.00 A 10.000 A	Combined accuracy 1.5% rdg. + 1.0% f.s. 1.5% rdg. + 5.5% f.s.	Current range 500.00 A 50.0000 A	Combined accuracy 2.5% rdg. + 1.1% f.s. 2.5% rdg. + 6.5% f.s.	Current range 2000.0 A 1000.0 A 500.00 A	Combined accuracy 2.0% rdg. + 1.75% f.s. 2.0% rdg. + 1.5% f.s. 2.0% rdg. + 2.5% f.s.
	45 to 66 Hz	100.00 A 10.000 A	1.1% rdg. + 0.6% f.s. 1.1% rdg. + 5.1% f.s.	500.00 A 50.0000 A	2.1% rdg. + 0.7% f.s. 2.1% rdg. + 6.1% f.s.	2000.0 A 1000.0 A 500.00 A	1.6% rdg. + 0.75% f.s. 1.6% rdg. + 1.1% f.s. 1.6% rdg. + 2.1% f.s.
Phase accuracy (45 to 66 Hz)	$\pm 1.8^\circ$ or less						
Offset drift	$\pm 0.5\%$ f.s. or less		$\pm 0.1\%$ f.s. or less				
Maximum allowable input (45 to 66 Hz)	100 A continuous		600 A continuous				
Maximum rated voltage to earth	600 V AC/DC (CAT IV)		1000 V AC/DC (CAT III), 600 V AC/DC (CAT IV)				
Frequency band	DC to 5 kHz (-3dB)						
Dimensions, mass, cord length	58 mm (2.28 in) W x 132 mm (5.20 in) H x 18 mm (0.71 in) D, 250 g (8.8 oz), 2.5 m (8.2 ft)	64 mm (2.52 in) W x 160 mm (6.30 in) H x 34 mm (1.34 in) D, 320 g (11.3 oz), 2.5 m (8.2 ft)	64 mm (2.52 in) W x 195 mm (7.68 in) H x 34 mm (1.34 in) D, 510 g (18.0 oz), 2.5 m (8.2 ft)				
Output connector	HIOKI PL14						

Model	AC LEAKAGE CURRENT SENSOR CT7116	
Appearance	  <p>Exclusively for leakage current measurement</p>	
Rated measurement current	6 A AC	
Measurable conductor diameter	Max. $\phi$ 40 mm (1.57 in)	
PQ3100 current range and combined amplitude accuracy (45 to 66 Hz)	Current range 5.0000 A 500.00 mA 50.0000 mA	Combined accuracy 1.1% rdg. + 0.16% f.s. 1.1% rdg. + 0.7% f.s. 1.1% rdg. + 6.1% f.s.
	$\pm 3^\circ$ or less	
	40 Hz to 5 kHz ( $\pm 3.0\%$ rdg. $\pm 0.1\%$ f.s.)	
Residual current characteristics	Max. 5 mA (in 100 A go and return electric wire)	
Effect of external magnetic fields	400 A AC/m corresponds to 5 mA, Max. 7.5 mA	
Dimensions, mass, cord length	74 mm (2.91 in) W x 145 mm (5.71 in) H x 42 mm (1.65 in) D, 340 g (12.0 oz), 2.5 m (8.2 ft)	
Output connector	HIOKI PL14	

### CONVERSION CABLE L9910



Used to connect the following current sensors to the PQ3100. (Output connector conversion: BNC to PL14)

CLAMP ON SENSOR  
9694, 9660, 9661, 9669

AC FLEXIBLE CURRENT SENSOR  
CT9667-01, CT9667-02, CT9667-03  
(Power cannot be supplied to these sensors from the PQ3100.)

CLAMP ON LEAK SENSOR  
9657-10, 9675

# PQ3100 Lineup

## POWER QUALITY ANALYZER KIT

Value Kits			
	Model	POWER QUALITY ANALYZER KIT PQ3100	POWER QUALITY ANALYZER KIT PQ3100
Model No. (Order Code)	<b>PQ3100-91</b>	<b>PQ3100-92</b>	<b>PQ3100-94</b>
Kit contents	POWER QUALITY ANALYZER PQ3100* : 1 AC CURRENT SENSOR CT7136 : 2 CARRYING CASE C1009 : 1 SD MEMORY CARD 2GB Z4001 : 1	POWER QUALITY ANALYZER PQ3100* : 1 AC CURRENT SENSOR CT7136 : 4 CARRYING CASE C1009 : 1 SD MEMORY CARD 2GB Z4001 : 1	POWER QUALITY ANALYZER PQ3100* : 1 AC FLEXIBLE CURRENT SENSOR CT7045 : 4 CARRYING CASE C1009 : 1 SD MEMORY CARD 2GB Z4001 : 1

\* PQ3100 accessories : Instruction manual, Measurement guide, VOLTAGE CORD L1000-05, Color clips, AC ADAPTER Z1002, Strap, USB cable, BATTERY PACK Z1003, PQ ONE (Software, CD)

### Current measurement options

AC CURRENT SENSOR CT7126	60 A AC, $\phi$ 15 mm (0.59")
AC CURRENT SENSOR CT7131	100 A AC, $\phi$ 15 mm (0.59")
AC CURRENT SENSOR CT7136	600 A AC, $\phi$ 46 mm (1.81")
AC FLEXIBLE CURRENT SENSOR CT7044	6000 A AC, $\phi$ 100 mm (3.94")
AC FLEXIBLE CURRENT SENSOR CT7045	6000 A AC, $\phi$ 180 mm (7.09")
AC FLEXIBLE CURRENT SENSOR CT7046	6000 A AC, $\phi$ 254 mm (10.0")
AC LEAKAGE CURRENT SENSOR CT7116	6 A AC, $\phi$ 40 mm (1.57")
AC/DC AUTO-ZERO CURRENT SENSOR CT7731	100 A AC, $\phi$ 33 mm (1.30")
AC/DC AUTO-ZERO CURRENT SENSOR CT7736	600 A AC, $\phi$ 33 mm (1.30")
AC/DC AUTO-ZERO CURRENT SENSOR CT7742	2000 A AC, $\phi$ 55 mm (2.17")
CONVERSION CABLE L9910 (BNC to PL14)	For BNC connector conversion

\*The connectors used on CT7000 series current sensors differ from those used on legacy products. To use a legacy sensors, use Conversion Cable L9910.

Hioki welcomes requests for quotations for customized specifications such as current sensor cord extensions, voltage cord extensions, and voltage cord tip changes. For more information, please contact your nearest Hioki distributor.

### Voltage measurement options



**MAGNETIC ADAPTER 9804-01 (red)**  
**MAGNETIC ADAPTER 9804-02 (black)**  
Magnetic tip for use with the standard Voltage Cord L1000-05 (generally compatible with M6 pan screws)

Red and black adapters sold separately. Purchase the quantity and color appropriate for your application. (Example: 3P3W - 3 adapters; 3P4W - 4 adapters)



**GRABBER CLIP 9243**  
Use with L1000-05 to change tip.

### Carrying cases, Water proof boxes




**CARRYING CASE C1009**  
Bag



**CARRYING CASE C1001**  
Soft case



**CARRYING CASE C1002**  
Hard case  
413Wx595Wx265D mm  
(16.3"Wx23.4"Hx10.4"D)  
5.7 kg (201 oz.)



**Waterproof box**  
For outdoor installation;  
IP65 compliant  
Contact Hioki for a quotation.

### Interfaces



SD MEMORY CARD 2GB Z4001



SD MEMORY CARD 8GB Z4003

#### IMPORTANT

Use only the SD memory card Z4001 or Z4003 sold by HIOKI.



**RS-232C CABLE 9637**  
Length: 1.8 m (5.91 ft)  
Cross, 9 pin to 9 pin



**LAN CABLE 9642**  
Length: 5 m (16.41 ft)  
supplied with straight to cross conversion cable

### Model : POWER QUALITY ANALYZER PQ3100



Model No. (Order Code): **PQ3100**  
For more information about accessories, see the specifications table above.

### Bundled accessories



**Voltage Cord L1000-05**  
5 cords (1 ea. black, red, yellow, green, and gray)  
Length: 3 m (9.84 ft)



**AC ADAPTER Z1002**  
Power supply for the PQ3100  
100V AC to 240V AC



**BATTERY PACK Z1003**  
(Ni-MH, 7.2 V/4500 mAh)

Note: Company names and Product names appearing in this catalog are trademarks or registered trademarks of various companies.

# HIOKI

HIOKI E. E. CORPORATION

#### HEADQUARTERS

81 Koizumi, Ueda, Nagano, 386-1192, Japan  
TEL +81-268-28-0562 FAX +81-268-28-0568  
http://www.hioki.com / E-mail: os-com@hioki.co.jp

#### HIOKI USA CORPORATION

TEL +1-609-409-9109 FAX +1-609-409-9108  
http://www.hiokiusa.com / E-mail: hioki@hiokiusa.com

HIOKI (Shanghai) SALES & TRADING CO., LTD.  
TEL +86-21-63910090 FAX +86-21-63910360  
http://www.hioki.cn / E-mail: info@hioki.com.cn

HIOKI SINGAPORE PTE. LTD.  
TEL +65-6634-7677 FAX +65-6634-7477  
E-mail: info-sg@hioki.com.sg

HIOKI KOREA CO., LTD.  
TEL +82-2-2183-8847 FAX +82-2-2183-3360  
E-mail: info-kr@hioki.co.jp

DISTRIBUTED BY