Regenerative Grid Simulator







PAS series is developed for renewable energy related applications. It can simulate the various grid conditions and related test standards. Especially for the voltage and frequency transient simulation test feature, which is very suitable for production, quality verification, research and development. It is also built with Low Voltage Ride Through (LVRT) and High Voltage Ride Through (HVRT) test function and gradual mode programmable capability.

PFV Series is a new generation of programmable AC power supply, with four quadrant energy feedback function. This unit not only provides power to the EUT, but also sinks the power back to the grid system which is very useful for grid-tied devices testing applications. The maximum output power for PAS series is up to 2000kVA, and the PFV series is up to 400kVA. The output voltage range is 0~300V(L-N) and the standard output frequency is 45~65Hz continuously adjustable (optional 40~70Hz).

Output Power

30kVA~2000kVA

Interfaces

RS-485 Standard RS-232 Option Ethernet USB

Product Features

- PAS has built-in low voltage ride through (LVRT) & high voltage ride through (HVRT) mode which can be easily used for simulating the abnormality test according to different test standards.
- PAS/PFV equip with energy feedback feature that feeds energy back into the grid system for saving energy and sinking the power from grid-tied devices.
- PAS series is suitable for standard verification. For example:UL1741, IEEE 1547, BDEW and CEI0-16, etc.
- Three phase independent voltage adjustment is suitable for three phase unbalance testing or multiple single phase test units. It also equips with phase angle adjustment.
- With input PFC, PAS s input PF is up to 0.99.
- Optional harmonics waveform synthesis function.

Applications

- O Laboratory/Certification Bureau
- O Electric Vehicles
- O Renewable Energy
- O Motor & Compressor

QR Code






Product Info.

Product Video

Regenerative **Function**

PV Inverter Testing Application

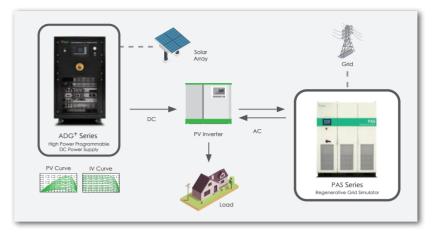


PAS series is a four-quadrant AC power source. Even in 2000kVA output power, it is capable to both sink and source over 90% efficiency from the DUT. It is suitable for PV Inverter test, EV charger test or other grid-tied devices test. Build in with Low Voltage Ride Through (LVRT) and High Voltage Ride Through (HVRT) test graph and it is very suitable for IEEE-1547 or BDEW related standards compliance test.


HVRT and LVRT NEW **Function**

■ Three Phase Independent Output Voltage Setting


Independent setting for three phase high/low voltage ride through to simulate voltage drop and surge.

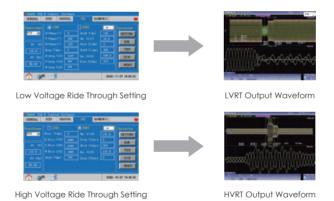

■ Low Voltage Ride Through Test - IEEE Std 1547.1-2020

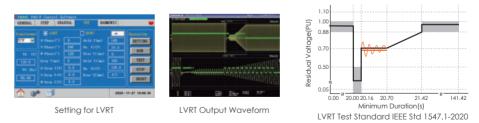

■ High Voltage Ride Through Test - IEEE Std 1547.1-2020




PAS built-in HVRT/LVRT function can simulate the situation when the abnormality is ruled out from the main AC grid. Simulations such as voltage drop, voltage restore or rising time and remaining time can all be programmed.


Ideal For Grid Simulation Applications

The PAS series is a grid simulator particularly designed and developed for renewable energy related applications. It has been widely applied for the testing applications of smart inverters, battery charging/ discharging, Power Conditioning System (PCS) and Vehicle-to-grid (V2G). The PAS series not only provides power to the EUT, but also sinks the power back to the grid system, which is suitable for grid testing application.

■ Power Conditioning System (PCS) Testing Application

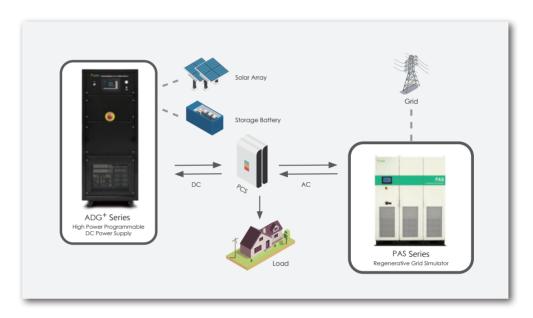


■ Vehicle-to-grid (V2G) Testing Application

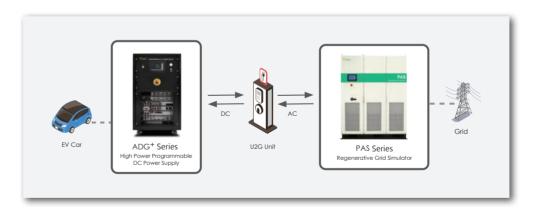

Harmonics Waveform **Synthesis Function (Opt.)**



Harmonics Waveform Synthesis Function Setting



Simulating Harmonics Waveform


PAS series harmonics waveform synthesis function can allow user to program multiplex distorted harmonic waveform of up to 25 steps. It can simply set up voltage and adjust start phase of each step base on fundamental frequency 50Hz or 60Hz.

Regenerative 2000kW Power Supply




Preen has successfully installed the 2000kW, smart inverter ATS in Taiwan's leading testing center for solar, renewable energy and PV inverter testing application.

Three Phase Independent **Adjustment**




The Three Phase Independent Adjustment function of PAS series can simulate advanced power line disturbance such as three-phase voltage imbalance or lost-phase, which can further meet up with standard of IEC61000-4-34 and GB/T 17626-34. To set output voltage of each phase independently, user can simply press the screen icon to switch between imbalance or unbalanced voltage setting for three phase independent voltage adjustment.

Phase Angle Adjustment (Opt.)

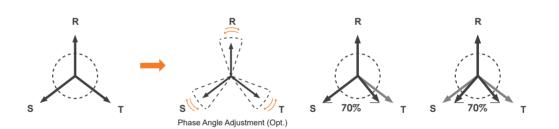

The PAS series is able to set the phase angle between three phases via the optional phase angle adjustment, for example, user can set phase angle from 120° to 70°, to simulate phase shift for different power conditions.

GRADUAL and **STEP Function**



Frequency Gradual Function

Voltage Step Function

PAS / PFV series have multiple programmable functions to precisely and effectively simulate various power line disturbances such as voltage or frequency ramp up or ramp down, transient and step changes.

PFV Series & PAS-F Series Three-Phase Output (30kVA - 1000kVA)

		PFV- 33030	PFV- 33045	PFV- 33060	PFV- 33075	PFV- 33100	PFV- 33120	PFV- 33150	PFV- 33200	PFV- 33300	PFV- 33400	-	-	-
Model		PAS-F-	PAS-F-	PAS-F-	PAS-F-	PAS-F-	PAS-F-	PAS-F-	PAS-F-	PAS-F-	PAS-F-	PAS-F-	PAS-F-	PAS-F
		33030	33045	33060	33075	33100	33120	33150	33200	33300	33400	33600	33800	-331000
INPUT														
Phase							30	ð / 3 Wire +	G					
Voltage*1								380V±15%						
Frequency								47-63Hz						
Max. Current*2		58.7A	88.1A	117.4A	146.8A	195.7A	234.9A	293.6A	391.4A	587.1A	782.8A	1174.3A	1565.7A	1957.1A
Power Factor							≥0.9	99(Max. Po	wer)					
OUTPUT														
Power (VA)		30kVA	45kVA	60kVA	75kVA	100kVA	120kVA	150kVA	200kVA	300kVA	400kVA	600kVA	800kVA	1000kVA
Phase								Ø / 4 Wire +						
Voltage Ranges Low(V)		0V-150.0V(L-N)												
PFV Series High(V)		0V-130.0V(L-N)												
Voltage Ranges PAS-F Series		0V-300.0V(L-N)												
Voltage Resolution								0.1V						
Voltage Accuracy							0.15	% F.S.+4 co	ounts					
Frequency Range		Standard : 45-65Hz Option : 40-70Hz												
Frequency Resolution								0.1Hz						
Frequency Accuracy		±0.1% F.S												
Max. Current (RMS)	Low(A)	83.3A	125A	166.7A	208.3A	277.8A	333.3A	416.7A	555.6A	833.3A	1111.1A	-	-	-
PFV Series	High(A)	41.6A	62.5A	83.3A	104.1A	138.9A	166.6A	208.3A	277.8A	416.7A	555.6A	-	-	-
Max.Current(RMS) PAS		41.6A	62.5A	83.3A	104.1A	138.9A	166.6A	208.3A	277.8A	416.7A	555.6A	833.3A	1111.1A	1388.8A
Line Regulation								≤ 1%						
Load Regulation							≤ 1%	(Resistive I	Load)					
Total Harmonic istortion(THD)								(Resistive I						
Response Time								≤ 2ms						
Crest Factor								≥ 3						
MEASUREMENT														
Voltage Range								0V-300.0V						
Voltage Resolution								0.1V						
Voltage Accuracy		0.1%F.S.+2counts												
Frequency Range		Standard : 45 ~ 65Hz Option : 40-70Hz												
Frequency Resolution		0.01Hz												
Frequency Accuracy		±0.01% F.S												
Current Range(RMS)		0-999A												
Current Resolution(RMS)		0.1A												
Current Accuracy(RMS	S)						0.19	6 F.S.+2 co	unts					
Power Range								0-1000kW						
Power Resolution								0.1kW						
Power Accuracy							0.29	6 F.S.+2 co	unts					
GENERAL														
Regenerative Function														
Low Voltage Ride Through(LVRT) High Voltage Ride Through(HVRT)								YES						
g. Foliage Ride IIIIO	ugh(LVRT)					F	PAS Series :		Series : NO)				
Three-phase independ adjustment	ugh(LVRT) ugh(HVRT)					F	PAS Series :		' Series : NO)				
Three-phase independ	ugh(LVRT) ugh(HVRT)					F	PAS Series :	YES, PFV	' Series : NO)				
Three-phase independ adjustment	ugh(LVRT) ugh(HVRT)					F		YES , PFV)				
Three-phase independ adjustment Phase Angle Setting	ugh(LVRT) ugh(HVRT)					F	≥ 92°	YES , PFV YES YES	ower ower)				
Three-phase independ adjustment Phase Angle Setting Efficiency	ugh(LVRT) ugh(HVRT)				Output		≥ 92° Touch Scre Input N.F.B	YES , PFV YES YES % at Max. Peen, 7" Colo,	ower	/oltage	perature			
Three-phase independ adjustment Phase Angle Setting Efficiency HMI	ugh(LVRT) ugh(HVRT)					Input:	≥ 929 Touch Scre Input N.F.B ge, Over Cu	YES , PFV YES YES % at Max. Peen, 7" Colo , Over Volta	rower or TFT LCD orge, Under \ orse Current	/oltage , Over Temp				
Three-phase independ adjustment Phase Angle Setting Efficiency HMI Protection	ugh(LVRT) ugh(HVRT) dent					Input : : Over Volta	≥ 92° Touch Scre Input N.F.B ge, Over Cu	YES , PFV YES YES % at Max. Peen, 7" Colo , Over Volta	ower or TFT LCD ge, Under \ erse Current or : GPIB, Etl	/oltage , Over Temp				
Three-phase independ adjustment Phase Angle Setting Efficiency HMI Protection Remote Interface	ugh(LVRT) ugh(HVRT) dent					Input : : Over Volta	≥ 92º Touch Scre Input N.F.B ge, Over CL RS-485, RS-	YES , PFV YES YES % at Max. Peen, 7" Colo , Over Volta Irrent, Reve	ower or TFT LCD nge, Under \ nrse Current nr: GPIB, Etl	/oltage , Over Temp				
Three-phase independ adjustment Phase Angle Setting Efficiency HMI Protection Remote Interface Operating Temperature	ugh(LVRT) ugh(HVRT) dent					Input : : Over Volta	≥ 92º Touch Scre Input N.F.B ge, Over CL RS-485, RS-	YES , PFV YES YES % at Max. P een, 7" Colc , Over Volta urrent, Reve 232 Optior 0°C ~ 45°C	ower or TFT LCD nge, Under \ nrse Current nr: GPIB, Etl	/oltage , Over Temp				
Three-phase independ adjustment Phase Angle Setting Efficiency HMI Protection Remote Interface Operating Temperature Humidity	ugh(LVRT) ugh(HVRT) dent	2000 x 12 mm /78.7- 31.49	4x 47.24 x		200 x 800 1x 47.24 x	Input : : Over Volta Standard : F	≥ 92º Touch Scre Input N.F.B ge, Over CL RS-485, RS-	YES , PFV YES YES % at Max. P een, 7" Colc , Over Volta rrent, Reve 232 Optior 0°C ~ 45°C (Non cond < 1,500m 0 x 800 mm	ower or TFT LCD oge, Under \ or SEPIB, Ett ensing)	/oltage , Over Temp hernet, USE 2050 :			1520 80.71 x	x 5635x Jam / 221.85 x 4 inch
Three-phase independ adjustment Phase Angle Setting Efficiency HMI Protection Remote Interface Operating Temperature Humidity Altitude	ugh(LVRT) ugh(HVRT) dent	mm /78.7	4x 47.24 x	mm /86.6	200 x 800 1x 47.24 x	Input : : Over Volta Standard : F	≥ 92°. Touch Scre Input N.F.B ge, Over Ct. RS-485, RS- 0~90% 2200 x 160	YES , PFV YES YES % at Max. P een, 7" Colc , Over Volta rrent, Reve 232 Optior 0°C ~ 45°C (Non cond < 1,500m 0 x 800 mm	ower or TFT LCD oge, Under \ or SEPIB, Ett ensing)	/oltage , Over Temp hernet, USE 2050 :	x 3530 x 15		1520 80.71 x)mm / 221.85 x

^{*1} Please contact for other voltage specification.
*2 The rated input voltage is 380V.
*3 Including wheels.

^{*} All specifications are subject to change without notice.

PAS-F Series Three-Phase Output (30kVA - 1000kVA)

ORDERING INFORMATION:

Model Number	Description
PAS-F 33030	Regenerative Grid Simulator (30kVA/300V/45-65Hz, Including LVRT Testing)
PAS-F 33045	Regenerative Grid Simulator (45kVA/300V/45-65Hz, Including LVRT Testing)
PAS-F 33060	Regenerative Grid Simulator (60kVA/300V/45-65Hz, Including LVRT Testing)
PAS-F 33075	Regenerative Grid Simulator (75kVA/300V/45-65Hz, Including LVRT Testing)
PAS-F 33100	Regenerative Grid Simulator (100kVA/300V/45-65H, Including LVRT Testing)
PAS-F 33120	Regenerative Grid Simulator (120kVA/300V/45-65Hz, Including LVRT Testing)
PAS-F 33150	Regenerative Grid Simulator (150kVA/300V/45-65Hz, Including LVRT Testing)
PAS-F 33200	Regenerative Grid Simulator (200kVA/300V/45-65Hz, Including LVRT Testing)
PAS-F 33300	Regenerative Grid Simulator (300kVA/300V/45-65Hz, Including LVRT Testing)
PAS-F 33400	Regenerative Grid Simulator (400kVA/300V/45-65Hz, Including LVRT Testing)
PAS-F 33600	Regenerative Grid Simulator (600kVA/300V/45-65Hz, Including LVRT Testing)
PAS-F 33800	Regenerative Grid Simulator (800kVA/300V/45-65Hz, Including LVRT Testing)
PAS-F 331000	Regenerative Grid Simulator (1000kVA/300V/45-65Hz, Including LVRT Testing)
PAS-F 001	Soft Start Function
PAS-F 002	GPIB Interface
PAS-F 003	Ethernet Interface
PAS-F 004	USB Interface
PAS-F 005	Output Frequency 40-70Hz
PAS-F 006	Output Voltage 0-350V(L-N)

PFV Series Three-Phase Output (30kVA - 400kVA)

Model Number	Description
PFV-33030	High Power Programmable AC Power Source (30kVA/300V/45-65Hz, Including Regenerative Function)
PFV-33045	High Power Programmable AC Power Source (45kVA/300V/45-65Hz, Including Regenerative Function)
PFV-33060	High Power Programmable AC Power Source (60kVA/300V/45-65Hz, Including Regenerative Function)
PFV-33075	High Power Programmable AC Power Source (75kVA/300V/45-65Hz, Including Regenerative Function)
PFV-33100	High Power Programmable AC Power Source (100kVA/300V/45-65Hz, Including Regenerative Function)
PFV-33120	High Power Programmable AC Power Source (120kVA/300V/45-65Hz, Including Regenerative Function)
PFV-33150	High Power Programmable AC Power Source (150kVA/300V/45-65Hz, Including Regenerative Function)
PFV-33200	High Power Programmable AC Power Source (200kVA/300V/45-65Hz, Including Regenerative Function)
PFV-33300	High Power Programmable AC Power Source (300kVA/300V/45-65Hz, Including Regenerative Function)
PFV-33400	High Power Programmable AC Power Source (400kVA/300V/45-65Hz, Including Regenerative Function)
PFV-001	Soft Start Function
PFV-002	GPIB Interface
PFV-003	Ethernet Interface
PFV-004	USB Interface